





ONTARIO FIRE DEPARTMENT FIRE PROTECTION STANDARD

FIRE HYDRANT IDENTIFICATION
STANDARD #D-002 EFFECTIVE 02-15-00 PAGES 1

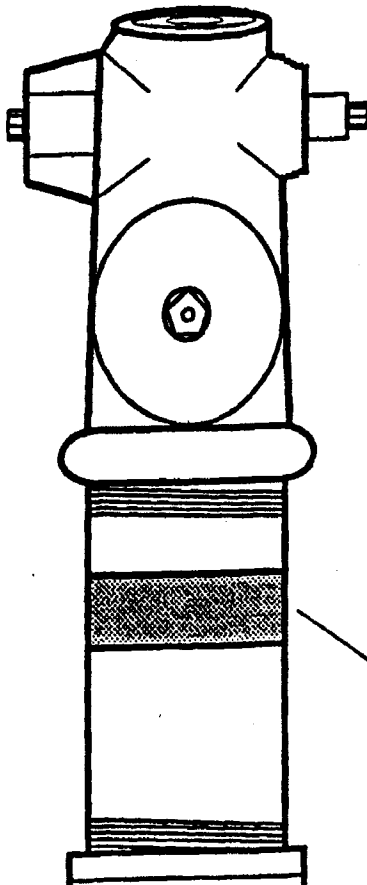

White Tape = Public Hydrant
Red Tape = Private Hydrant

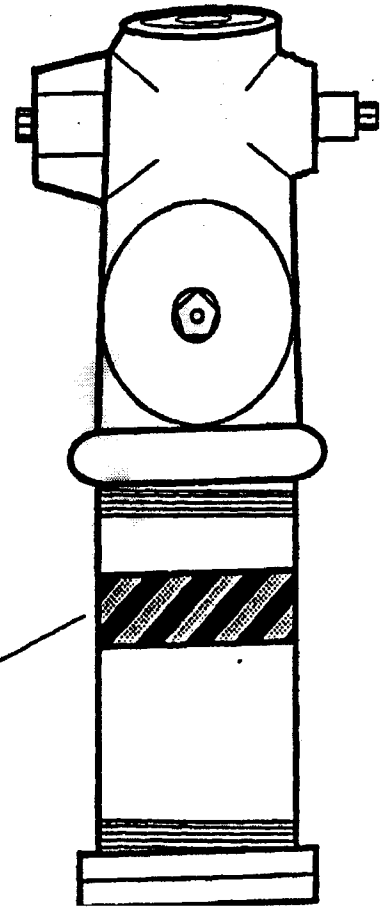

Yellow/Black Stripe Tape =
Private Hydrant Supplied by Fire Pump

4" REFLECTIVE TAPE

PURPOSE:

This standard is provided to serve as a visual example of the proper identification measures for fire hydrants in the City of Ontario.

SPECIFICATIONS:

1. Prime coat must be Rustoleum No. 960 Rust Inhibitive Yellow Primer or approved equal.
2. Finished paint coat shall be Old Quaker Envirogloss Yellow Exterior Enamel (EN 21712015) or approved equal.
3. Reflective tape shall be 4" wide self-adhesive tape applied with a 1.5" overlap of the seam. Red and white to be 3-M #PT-10; yellow/black to be Reflexite AP-1000 or approved equal.
4. Install blue reflective pavement marker per City of Ontario Standard Drawing No. 4302.
5. Do not paint brass hydrant threads.