




ONTARIO FIRE DEPARTMENT FIRE PROTECTION STANDARD

ON-SITE HYDRANTS

STANDARD #D-005

EFFECTIVE 11-08-05 PAGES 1

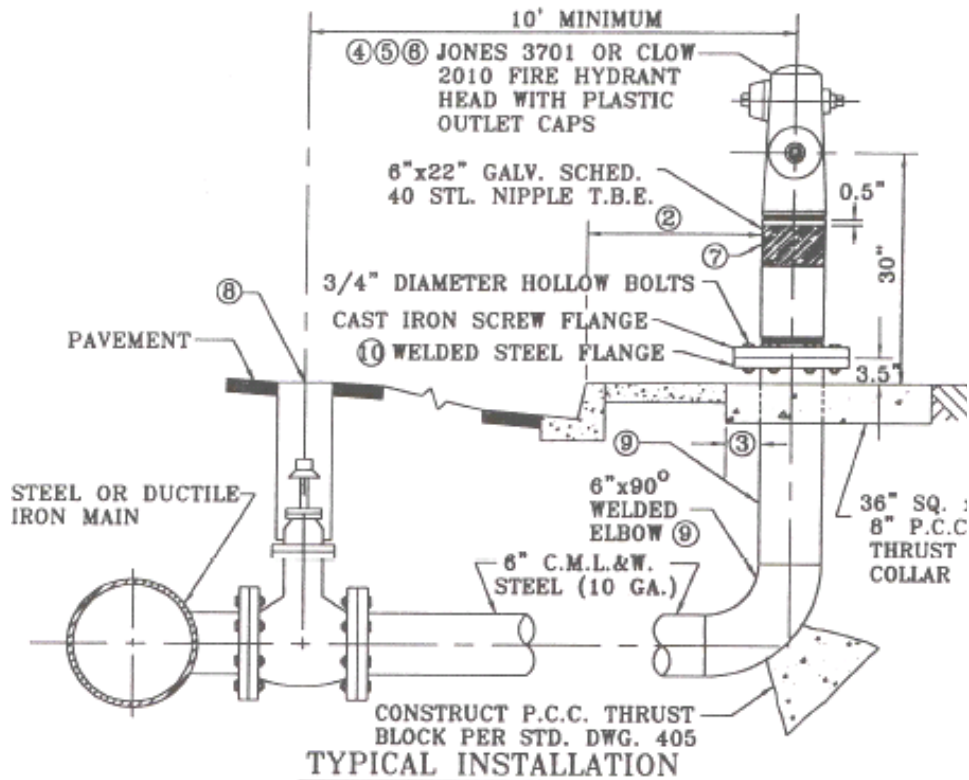

NOT TO SCALE

NOTES

1. FIRE HYDRANT SHALL BE INSTALLED NOT CLOSER THAN FIVE FEET FROM A DRIVEWAY, STREET LIGHT, POWER POLE SIGN, ETC.
2. 20" BEHIND CURB FACE WHEN THE SIDEWALK IS ADJACENT TO THE RIGHT-OF-WAY.
3. 12" BACK OF WALK WHEN SIDEWALK IS ADJACENT TO CURB.
4. PRIME COAT SHALL BE RUSTOLEUM NO. 960 RUST INHIBITIVE YELLOW PRIMER OR CITY ENGINEER APPROVED EQUAL
5. INSTALL BLUE REFLECTIVE PAVEMENT MARKER PER STANDARD DRAWING NO. 4004
6. FINISHED PAINT COAT SHALL BE OD QUAKER ENVIROGLOSS YELLOW EXTERIOR ENAMEL (EN21712015), OR CITY ENGINEER APPROVED EQUAL.
7. 4 INCH WIDE REFLEXITE AP-1000 PER OFD STD #D-002 APPLIED WITH 1.5 INCH OVERLAP OF SEAM.
8. GATE VALVE PER STANDARD DRAWING NO. 4028.
9. 6" C.M.L.&W. SCHEDULE 40 STEEL PIPE.
10. STANDARD 8 3/4" DIAMETER BOLT PATTERN WELDED STEEL FLANGE

