


PROFILE VIEW

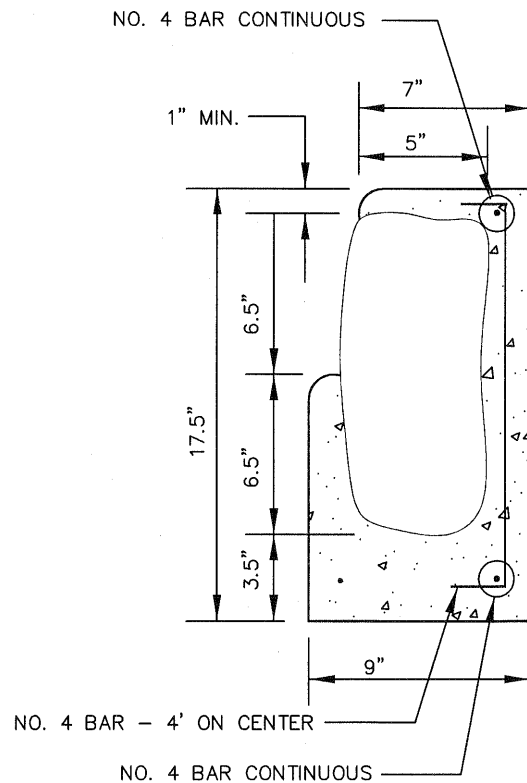

SECTION A-A

### NOTES

1. CONCRETE SHALL BE CLASS 520-D-2500 PER SECTION 201 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, LATEST EDITION.
2. CURING COMPOUND SHALL BE TYPE 1-D PER SECTION 201 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, LATEST EDITION.
3. LONGITUDINAL RE-BAR SHALL HAVE SLIP JOINTS AT 60' ON CENTER AND CUT PLATES AT 20' ON CENTER.



APPROVED BY: <i>John P. Sullivan</i> 24079 8/08/06				
JOHN P. SULLIVAN CITY ENGINEER RCE DATE				
RECOMMENDED: <i>Jim Minnema</i> 33340 8/07/06				
ASSISTANT CITY ENGINEER RCE DATE				
REV	DESCRIPTION	BY	APP'D	DATE

CITY OF ONTARIO

ROCK CURB DETAIL

STANDARD  
DRAWING  
NUMBER

**1202**