



PLAN A

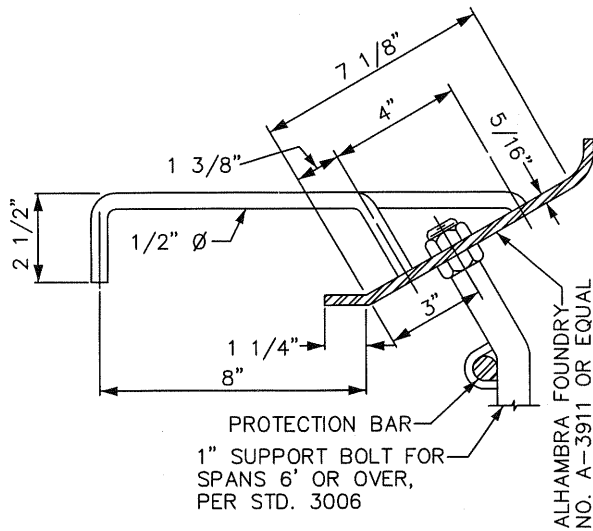

ANCHOR DETAIL

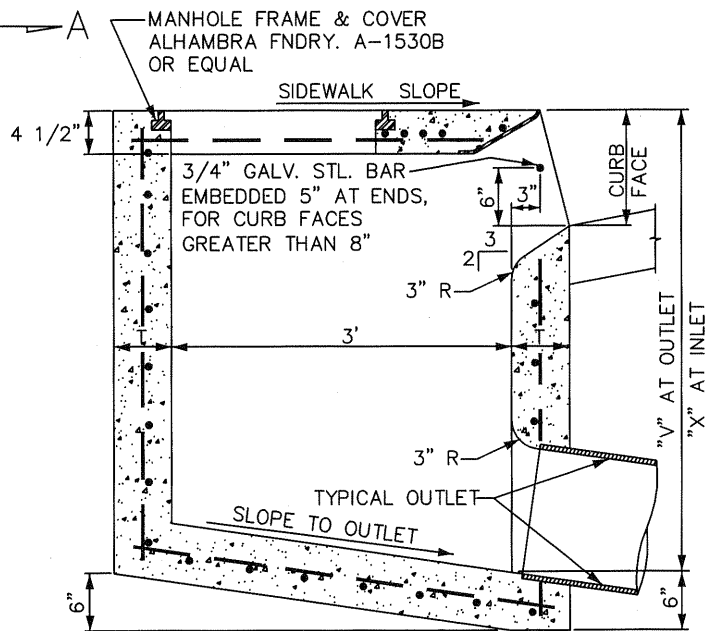

SECTION A-A

NOTES

1. ALL EXPOSED METAL PARTS SHALL BE GALVANIZED.
2. "V" = 3.5' UNLESS OTHERWISE SPECIFIED.
3. OUTLET PIPE MAY BE PLACED IN ANY POSITION AROUND WALLS.
4. CURB FACE AT C.B. OPENING SHALL BE THAT OF THE STANDARD CURB PLUS 4" OR AS OTHERWISE SHOWN.
5. CONCRETE SHALL BE CLASS 560-C-3250 PER SECTION 201-1 S.S. PWC.
6. SEE STANDARD DRAWING NO 3004 FOR STEEL REINFORCEMENT AND WALL THICKNESS.



APPROVED BY: <i>John P. Sullivan</i>				
24079 8/08/06				
JOHN P. SULLIVAN CITY ENGINEER RCE DATE				
RECOMMENDED: <i>Jim Min Mack</i>				
33340 8/07/06				
JIM MIN MACK ASSISTANT CITY ENGINEER RCE DATE				
REV	DESCRIPTION	BY	APP'D	DATE

CITY OF ONTARIO

CATCH BASIN NO. 2

STANDARD
DRAWING
NUMBER

3003