

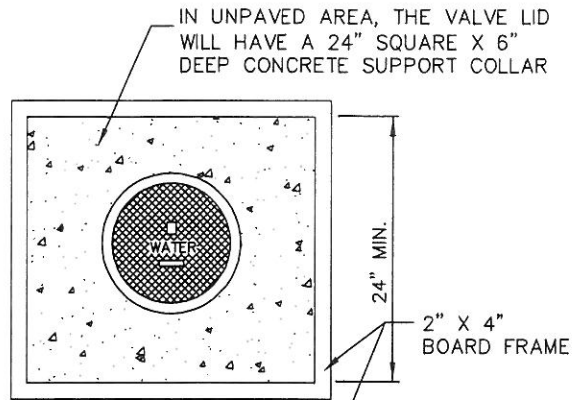
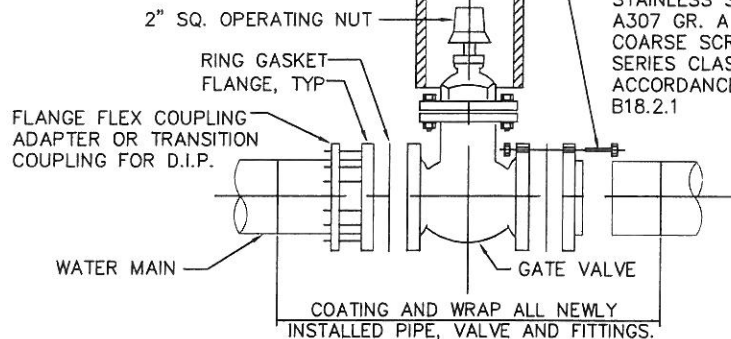
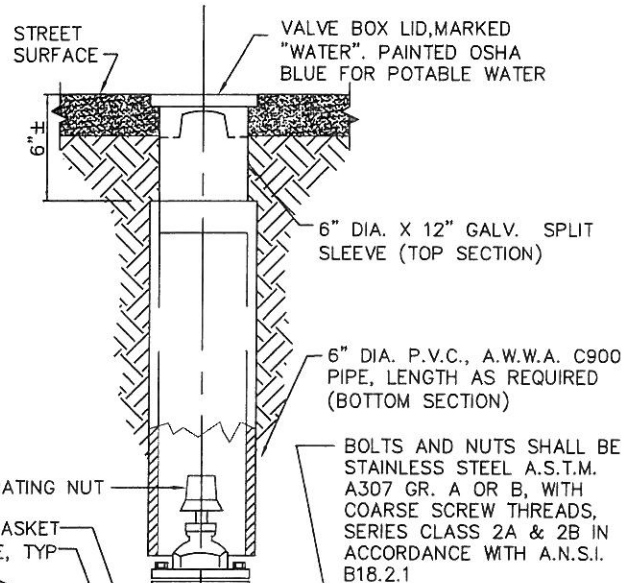
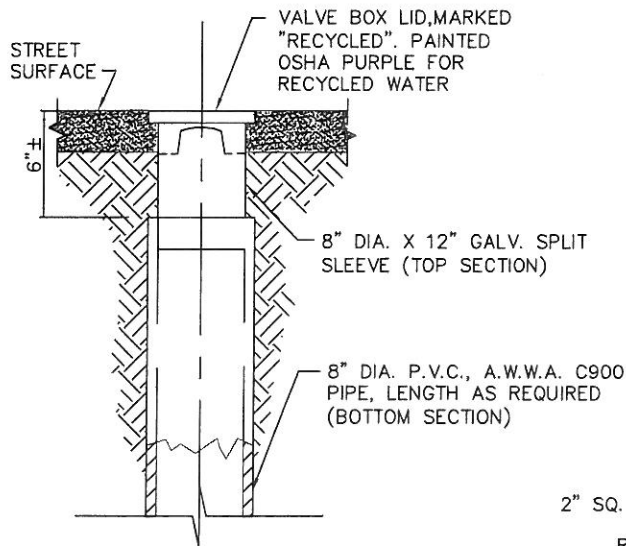


RECYCLED WATER LID



POTABLE WATER LID



#### NOTES

- ① ALL GATE VALVES SHALL BE FLANGED A.W.W.A. C509 OR APPROVED EQUAL.
- ② VALVES LOCATED IN UNPAVED AREAS SHALL HAVE A CONCRETE SUPPORT COLLAR AROUND THE LID.
- ③ INTERIOR & EXTERIOR COATING SYSTEM AND WRAP TO BE APPROVED BY THE CITY.
- ④ GATE VALVE TO BE USED ON WATERLINES 12" AND SMALLER.



APPROVED BY:		11-22-10	
<i>Louis Abi-Younes</i>		44485	
LOUIS ABI-YOUNES, CITY ENGINEER		RCE	DATE
RECOMMENDED:		12/25/10	
<i>Scott Burton</i>		57875	
SCOTT BURTON, UTILITIES ENG/OPERATIONS DIRECTOR		RCE	DATE
REV	DESCRIPTION	BY	APP'D DATE

CITY OF ONTARIO

GATE VALVE AND BOX

STANDARD  
DRAWING  
NUMBER

4005