


1. ALL FIRE HYDRANTS SHALL HAVE GUARD POST
2. INSTALL BLUE RETRO-REFLECTIVE PAVEMENT MARKER ON ALL FIRE HYDRANTS (TWO AT INTERSECTIONS) IN ACCORDANCE WITH CITY OF ONTARIO FIRE DEPARTMENT LOCATION RECOMMENDATIONS.
3. ALL NEW FIRE HYDRANTS SHALL BE BAGGED (GUNY SACK) UNTIL CONNECTING SYSTEM IS FULLY ACTIVATED.

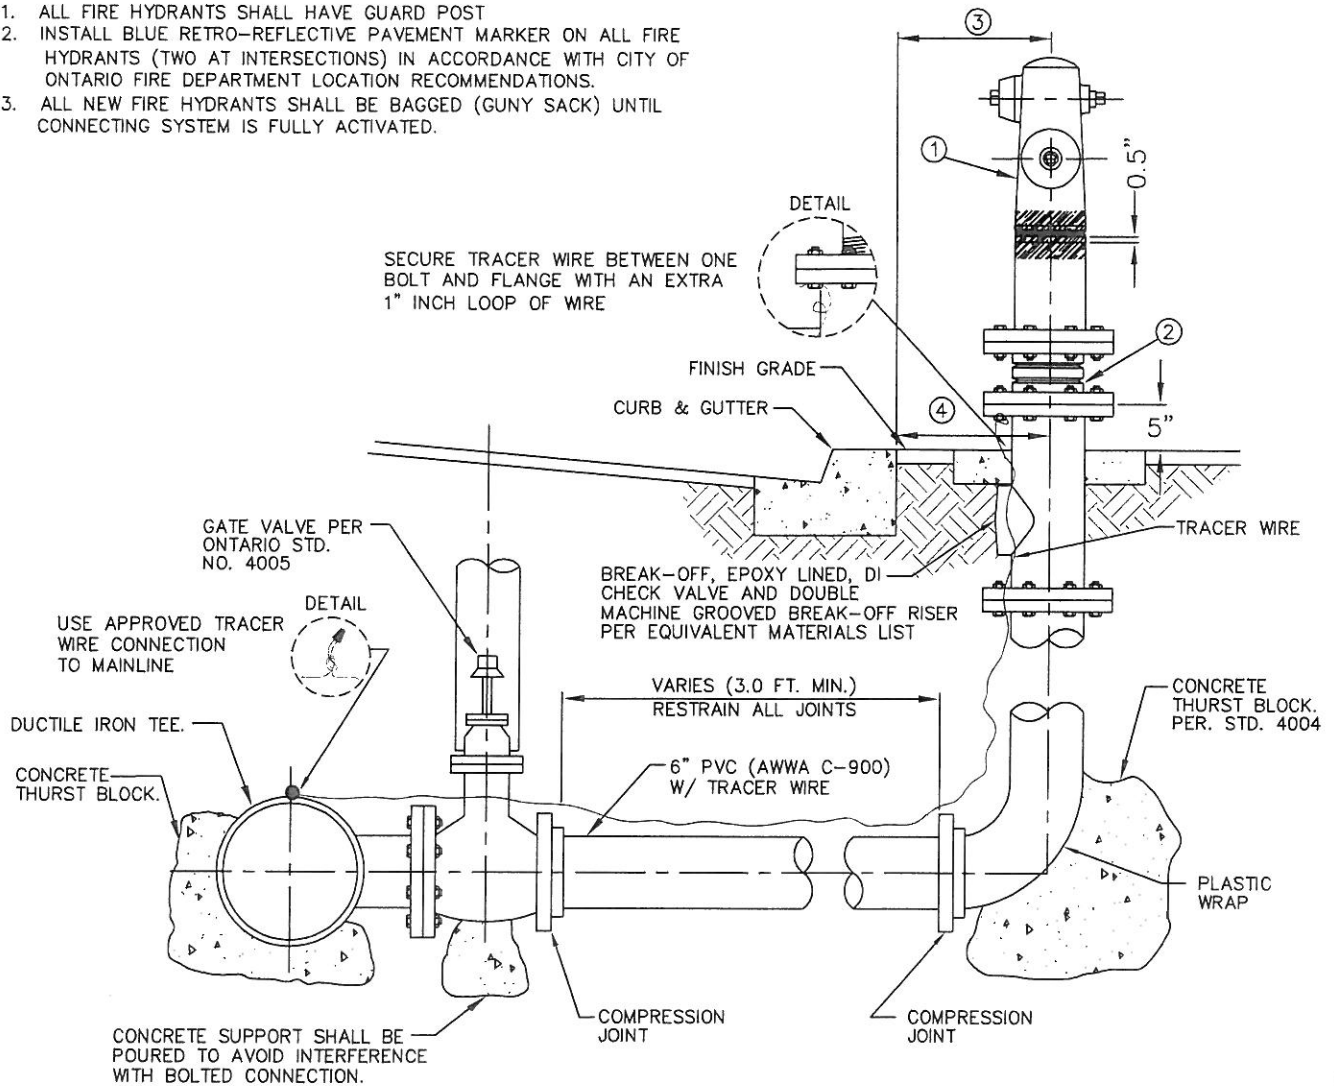

HYDRANTS AND/OR BLOW OFFS TO BE PAINTED WITH PRIMER AND TWO (2) COATS OF YELLOW ACME PAINT. NO. 2-19057 OR APPROVED EQUAL. (NO PAINT ON BRASS OR BRONZE).

NOTES

- ① STANDARD FIRE HYDRANT, HEAD & FLUTED SPOOL COMPLETE. 1-4' STEAMER HOUSE OUTLET & 1-2 1/2" HOUSE OUTLET. 8 HOLE PATTERN.
- ② 6" DIA. C.I. BREAK-OFF SPOOL. 6" LONG, ONE END FLG'D. TO MATE W/6' A.S.A. 150# SLIP-ON FLG., OTHER END FLG'D. TO MATE HYDRANT SPOOL. (SHOP FABRICATED).
- ③ 18" BEHIND CURB WHEN THE SIDEWALK IS ADJACENT TO THE RIGHT-OF-WAY.
- ④ 18" BACK OF SIDEWALK WHEN SIDEWALK IS ADJACENT TO CURB.



APPROVED BY:		11-22-10	
LOUIS ABI-YOUNES, CITY ENGINEER		44485	
RECOMMENDED:		10/25/10	
SCOTT BURTON, UTILITIES ENG/OPERATIONS DIRECTOR		57875	
REV	DESCRIPTION	BY	APP'D DATE

CITY OF ONTARIO

6" FIRE HYDRANT
INSTALLATION
(PVC PIPE)

STANDARD
DRAWING
NUMBER

4111