


1. ALL BLOW-OFFS SHALL HAVE GUARD POST IN UNPAVED AREAS PER STD. 4303
2. TRACER WIRE TO BE TAPED TO PIPELINE EVERY 10 FT.
3. HYDRANTS AND/OR BLOW OFFS TO BE PAINTED WITH PRIMER AND TWO (2) COATS OF YELLOW ACME PAINT. NO. 2-19057 OR APPROVED EQUAL. (NO PAINT ON BRASS OR BRONZE).



NOTES

- ① 18" BEHIND CURB WHEN THE SIDEWALK IS ADJACENT TO THE RIGHT-OF-WAY.
- ② 18" BACK OF SIDEWALK WHEN SIDEWALK IS ADJACENT TO CURB.

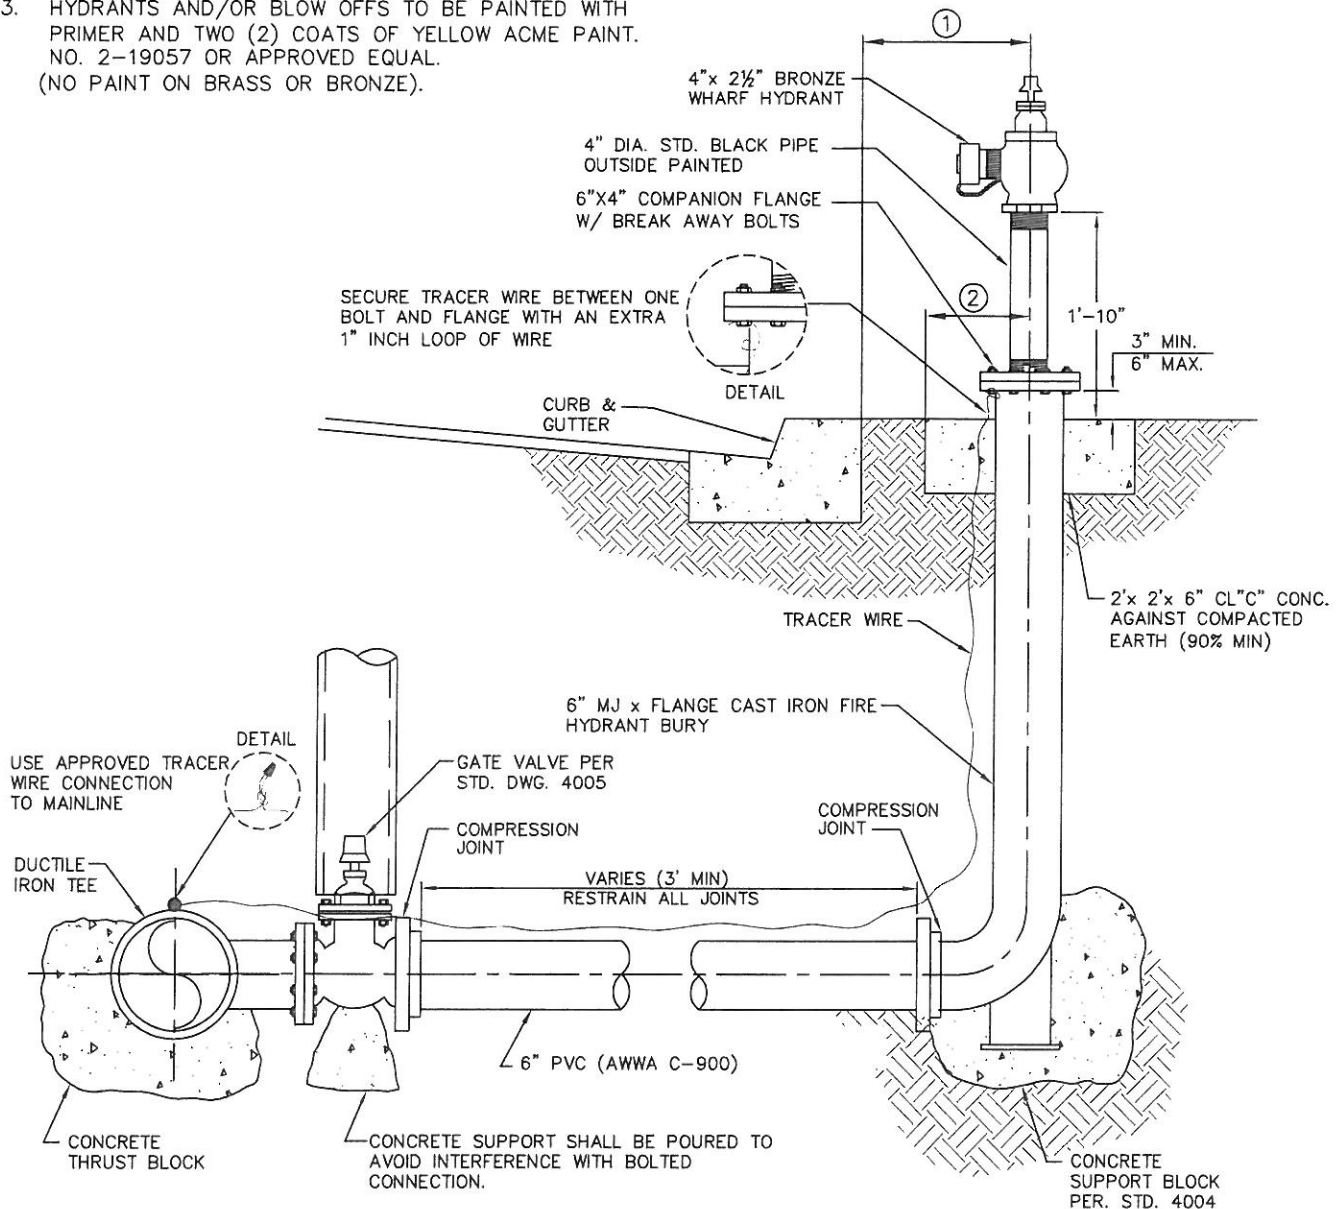

APPROVED BY:		11-22-10	
LOUIS ABI-YOUNES, CITY ENGINEER		44485	
RECOMMENDED:		10/25/10	
SCOTT BURTON, UTILITIES ENG/OPERATIONS DIRECTOR		57875	
REV	DESCRIPTION	BY	APP'D DATE

CITY OF ONTARIO

4" BLOWOFF ASSEMBLY
(PVC PIPE)

STANDARD
DRAWING
NUMBER

4112