


**NOTES:**

BOLTS, NUTS AND WASHERS SHALL BE MADE OF TYPE 316 STAINLESS STEEL, CLASS 2, CONFORMING TO ASTM A193 FOR BOLTS AND TO ASTM A 194 FOR NUTS.

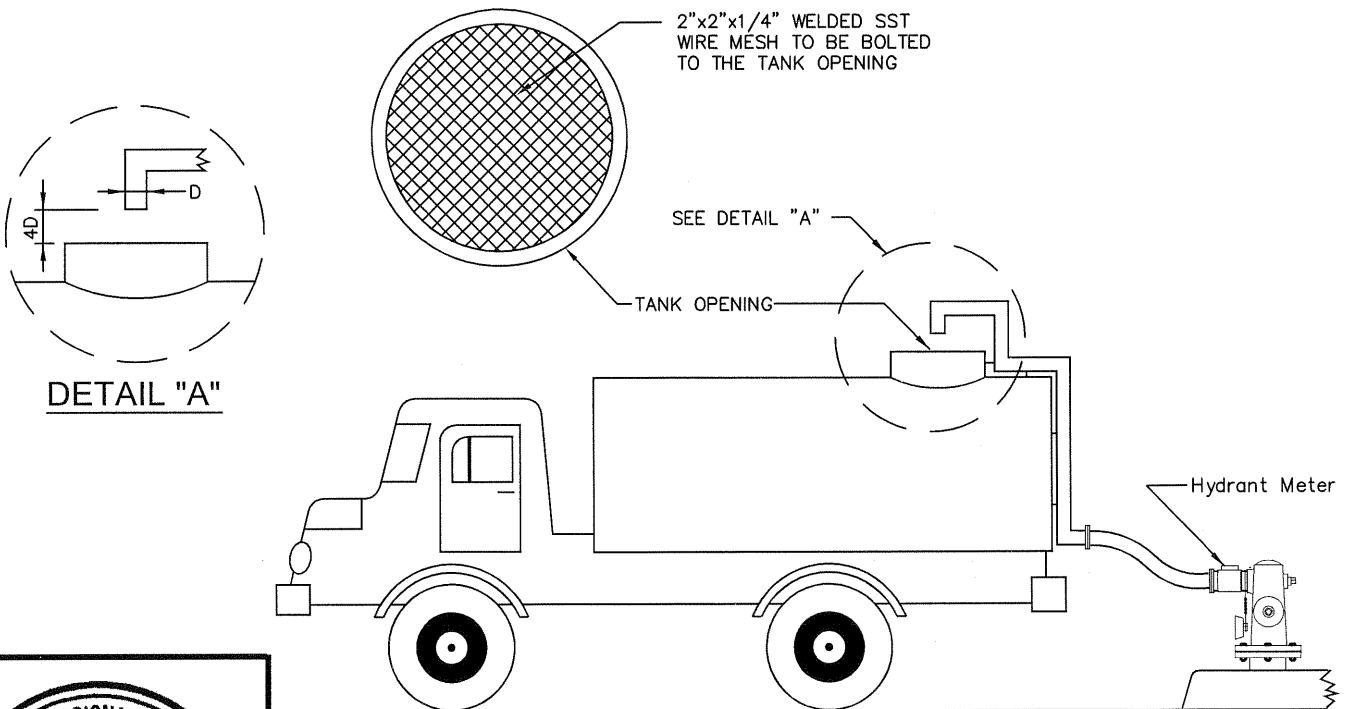

APPROVED BY:		24079 4/1/5	
<i>John P. Sullivan</i>		RCE DATE	
JOHN P. SULLIVAN CITY ENGINEER			
RECOMMENDED:		57875 3/14/5	
<i>Scott Burt</i>		RCE DATE	
ASST. UTIL. DIRECTOR/ENG.			
REV	DESCRIPTION	BY	APP'D DATE

CITY OF ONTARIO

ALLOWABLE METHODS  
FOR FIRE HYDRANT  
CONNECTIONS

STANDARD  
DRAWING  
NUMBER

**4301**