



MATERIAL LIST

- ① 1" OR 2" DOUBLE STRAP BRONZE SERVICE SADDLE
- ② 1" OR 2" BRONZE CORPORATION STOP BALL VALVE
- ③ 1" OR 2" 90° LONG RADIUS SILVER SOLDER SWEAT COPPER OR BRASS ELBOW
- ④ 1" OR 2" RIGID TYPE "K" COPPER TUBING
- ⑤ 2" MIP THREAD x SWEAT ADAPTER
- ⑥ 1" OR 2" BRONZE BALL VALVE
- ⑦ CONTRACTORS HYDROSTATIC TEST PUMP
- ⑧ POTABLE WATER TANK
- ⑨ HIGH PRESSURE TEST PUMP (350 PSI)
- ⑩ PRESSURE REGULATOR
- ⑪ 5/8" HIGH PRESSURE WATER METER
- ⑫ 3/4" VALVE & PRESSURE GAUGE (350 PSI)
- ⑬ 3/4" HIGH PRESSURE HOSE OR COPPER PIPE
- ⑭ 3/4" BRASS TEES PRESSURE GAUGE AND VALVE



CML&C STEEL PIPE

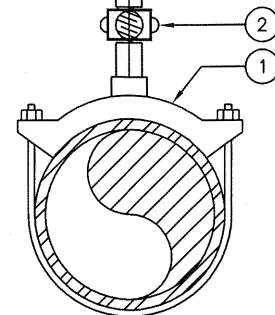

DUCTILE IRON PIPE

NOTE

1. CONTRACTOR SHALL TEST ALL PIPELINES AND APPURTENANCES @ 50 PSI OVER THE CLASS/RATING OF THE PIPE UNLESS OTHERWISE NOTED IN THE PROJECT PLANS AND SPECIFICATIONS.
2. LIMITS OF REMOVAL OF TEMPORARY FACILITIES ARE SUBJECT TO CITY APPROVAL.



APPROVED BY: <i>John P. Sullivan</i>				
JOHN P. SULLIVAN CITY ENGINEER				
RECOMMENDED: <i>Scott Burt</i>			24079	4/1/5
ASST. UTIL. DIRECTOR/ENG.			RCE	DATE
REV	DESCRIPTION	BY	APP'D	DATE

CITY OF ONTARIO

**1" TEMPORARY
HYDROSTATIC
PIPELINE TESTING
INSTALLATION**

STANDARD
DRAWING
NUMBER

4305