



1. ALL BLOW OFFS IN UNPAVED AREAS SHALL HAVE GUARD POST IN UNPAVED AREAS PER STD. 4303.
2. TRACER WIRE TO BE TAPED TO PIPELINE EVERY 10 FT.
3. HYDRANTS AND/OR BLOW OFFS TO BE PAINTED WITH PRIMER AND TWO (2) COATS OF YELLOW ACME PAINT. NO. 2-19057 OR APPROVED EQUAL. (NO PAINT ON BRASS OR BRONZE).

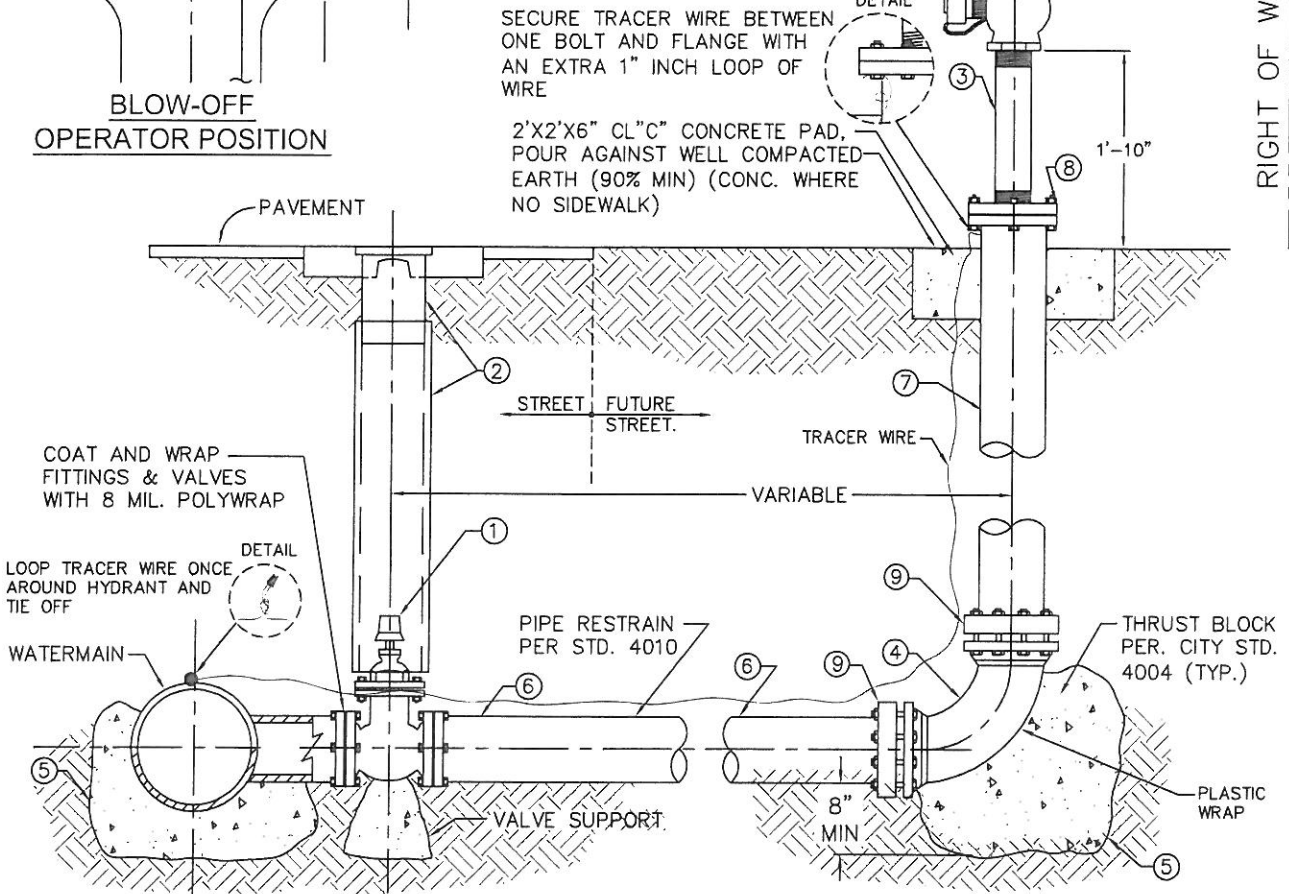

NOTES

- ① 8" DIA. A.W.W.A. C-509 (LATEST) FLG'D. RESELIENT RESILIENT SEAT GATE VALVE, PER STD. DWG. 4005
- ② STANDARD VALVE BOX INSTALLATION PER STD. 4005
- ③ 4" DIA. STD. GAV. NIPPLE, OUTSIDE PAINTED.
- ④ 8" DIA. MJ 90° BEND
- ⑤ THRUST BLOCK PER STD. DWG. 4004
- ⑥ 8" DIA. PVC AWWA C-900 W/ LOCATER WIRE
- ⑦ 8" D.I. FLANGE X SLIP SPOOL
- ⑧ 8"X4" COMPANION FLANGE (A.S.A. 150LB.)
- ⑨ PIPE RESTRAINT

- ⑩ M.J. X FLANGE 90° BEND
- ⑪ M.J. X FLANGE REDUCER

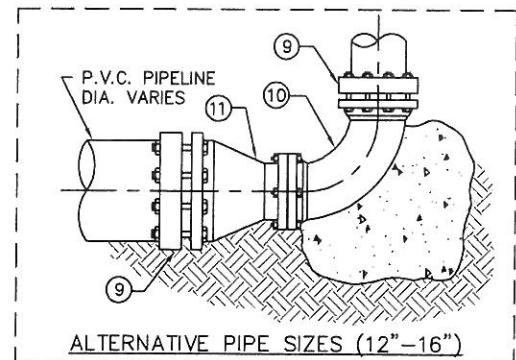

APPROVED BY: <i>Louis Abi-Younes</i> 11-22-10				
LOUIS ABI-YOUNES, CITY ENGINEER 44485 RCE DATE				
RECOMMENDED: <i>Scott Burton</i> 10/25/10				
SCOTT BURTON, UTILITIES ENG/OPERATIONS DIRECTOR RCE 57875 DATE				
REV	DESCRIPTION	BY	APP'D	DATE

CITY OF ONTARIO

NMC
TEMPORARY DEAD-END
4" BLOWOFF

STANDARD
DRAWING
NUMBER

4113